


VENTILATION

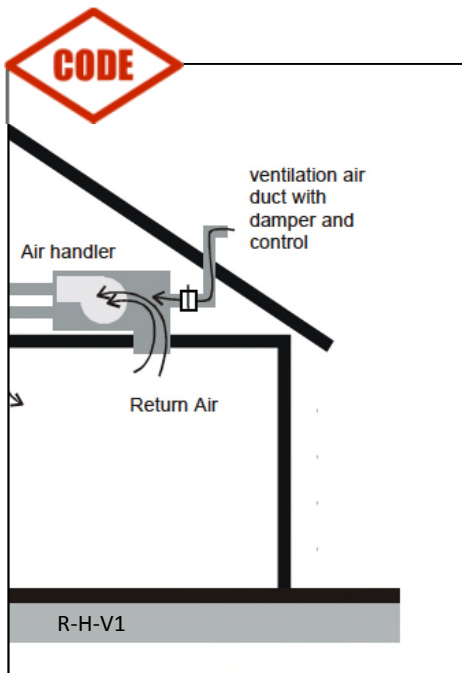

Whole Building Ventilation


All dwelling units shall meet the requirements of ASHRAE Standard 62.2, Ventilation and Acceptable Indoor Air Quality in Low-Rise Residential Buildings.

Window operation is not a permissible method of providing the Whole-Building Ventilation airflow.

Continuous operation of central forced air system air handlers used in central fan integrated ventilation systems is not a permissible method of providing the whole-building ventilation airflow.

The Whole-Building Ventilation airflow shall be confirmed through field verification and diagnostic testing (by a HERS Rater).

Code Reference: 2016 Title 24, Part 6 Standards §150.0(o)

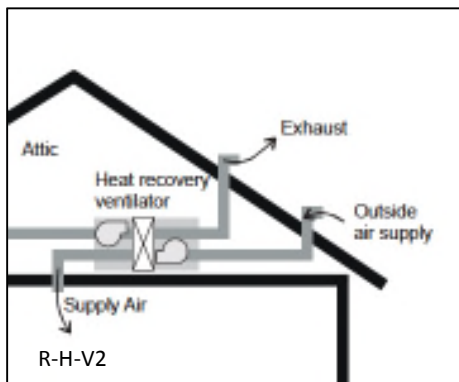

HVAC

VENTILATION

Notes:
